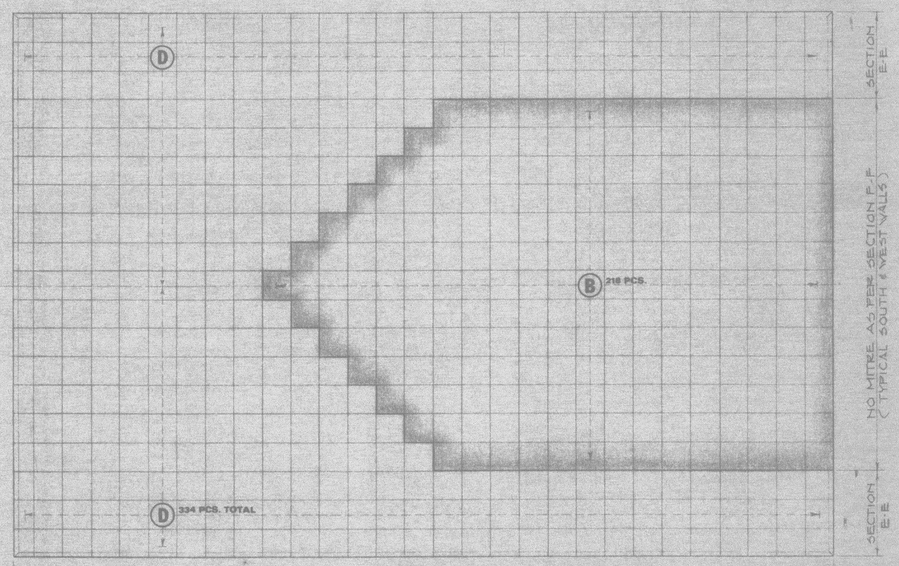

SOUTH WALL
3/16" = 1'-0"

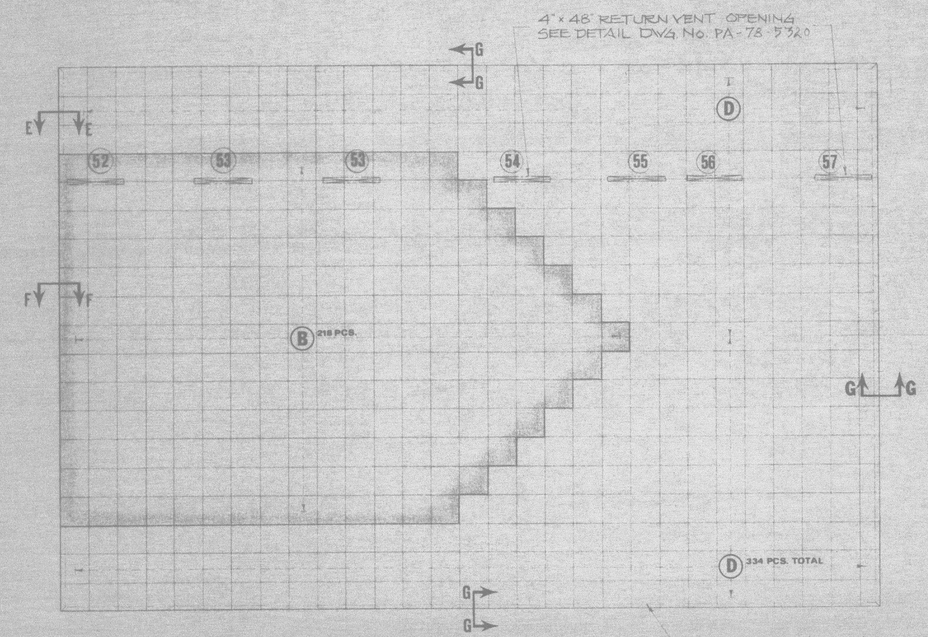

WEST WALL
3/16" = 1'-0"

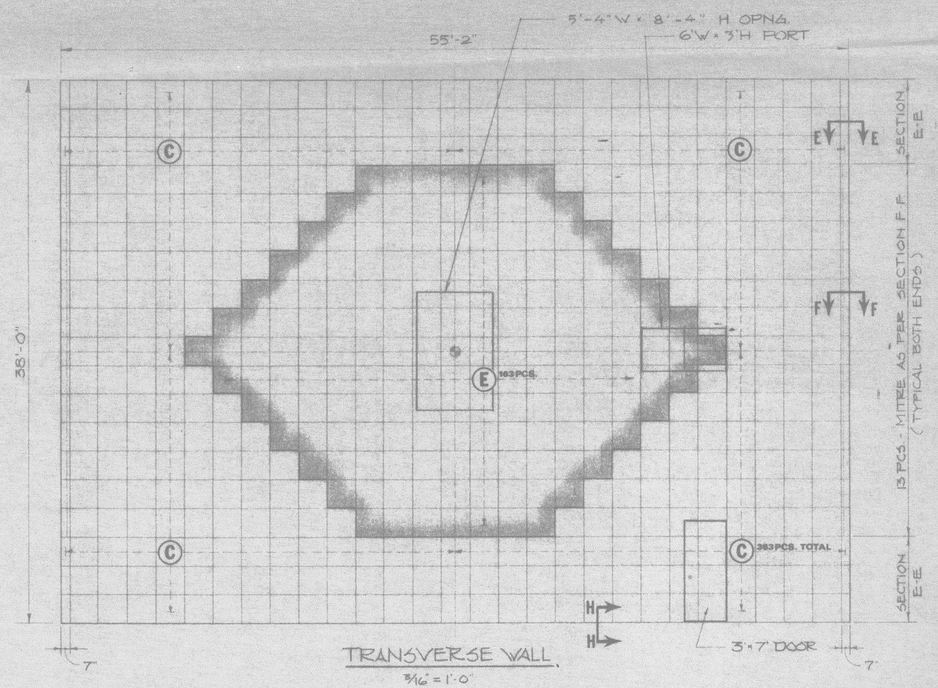

TRANSVERSE WALL
3/16" = 1'-0"

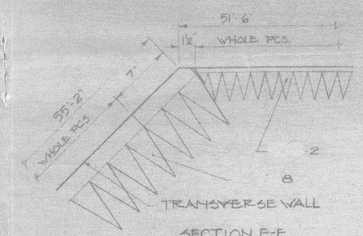

SECTION E-E
1½" = 1'-0"

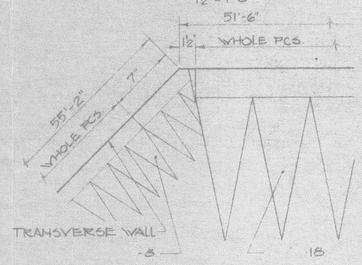

SECTION F-F
1½" = 1'-0"

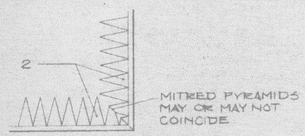

SECTION G-G
1½" = 1'-0"



SECTION H-H
(SIMILAR AT CEILING)
1½" = 1'-0"

INSTALLATION SEQUENCE:

1. MOUNT -ON TRANSVERSE WALL FIRST; THE EXACT LOCATION OF ON SIDE WALLS DEPENDS ON -8 OVERHANG AT EDGE.
- ALWAYS LAYOUT 2'x2' SQUARES ON MOUNTING SURFACE. TRIM THE PIECES TO FIT THE INDIVIDUAL SQUARES.
- WORK FROM VERTICAL ℄ TOWARD EDGES. FINISH EDGE AS PER SECTIONS E-E AND F-F.
2. SOUTH AND WEST WALLS - START MOUNTING AT TRANSVERSE WALL EDGE AND WORK TOWARD BILLBOARD.
- MITER EDGES AS PER DETAILS E-E, F-F & G-G.
- THE 1½" DIMENSION IN SECTIONS E-E & F-F MAY CHANGE DUE TO VARIATIONS IN THE WALL DIMENSIONS.
- ALL CUTS TO BE MADE AT SITE FOR NEAT INTERFACE

LEGEND

(A) =	26·NRL
(B) =	18·NRL
(C) =	8·NRL
(D) =	2·NRL
(E) =	12·NRL

STATEMENT OF APPROVAL

THIS DRAWING IS APPROVED ONLY FOR GENERAL CONFIGURATION AND FOR THE DETAILS LISTED BELOW. THIS APPROVAL DOES NOT RELIEVE THE SELLER OF HIS RESPONSIBILITY TO PROPERLY DESIGN, BUILD AND/OR INSTALL THE EQUIPMENT OR FACILITY; NOR DOES IT RELIEVE HIM OF ANY WARRANTY OR OTHER OBLIGATION SET FORTH IN THE CONTRACT AGREEMENT.

THE BOEING COMPANY
BY: R T Ball
DATE: 6/21/77

NO.	REVISION (WAS)	DR.	CK.	APR.	DATE
A	AIR VENT RETURNS WERE NOT IDENTIFIED. TRANSVERSE WALL - OPENING & PORT DIMENSION WERE 11'-1¼" x 14'-11¾" & 6x3" RESPECT	E.S.	RB	WHE	6/29/77

ANECHOIC CHAMBER

LAYOUT SH. 2 OF 4

DR.	DATE	ENG.	DATE	EL'C.	DATE
DDM	3 25 77	RB	6 23 77	WHE	3/31/77
CK.	DATE		DATE	EXEC.	DATE

SCALE	ACCT.	DWG. NO.
AS SHOWN	BOEING ENGR. & CONST. SEATTLE, WASHINGTON	D·78·5324·A

MILLER BLUE PRINT CO., INC. 14230