INAL	COMPONENT
	SS23, SS24
	ALL PILOT LIGHTS, HS1
	SS23, SS24, PL60A
4	SS24
DA	SS24
	SS24, PL60A
	SS23, SS42, SS43, SS44, PL28B, HS1
	SS24, PL36B
2A	SS23
	SS42, PL46
	SS43, PL49
30	SS28
31	SS41
34	SS41
35	SS41
36	SS41, PL37A
37	SS41, PL37B
38	SS23A
39	SS23A
41	SS23A, PL28A
21	PL47
23	PL48
24	PL50
25	SS44
06	PL15D
02	CI1, PS1, TR, PS2, PS3
07	CI1, PS1, TR, PS2 PS3

QM	LN2 STORAGE TANK
NAL	COMPONENT
T4	45A(-)
1A	16A(+) 18A(-)
-1	37A(+) 38A(-)
3 -	27A(+) [redacted](-)
V-2	381, 302
V-1	385, 302
A	PT-60

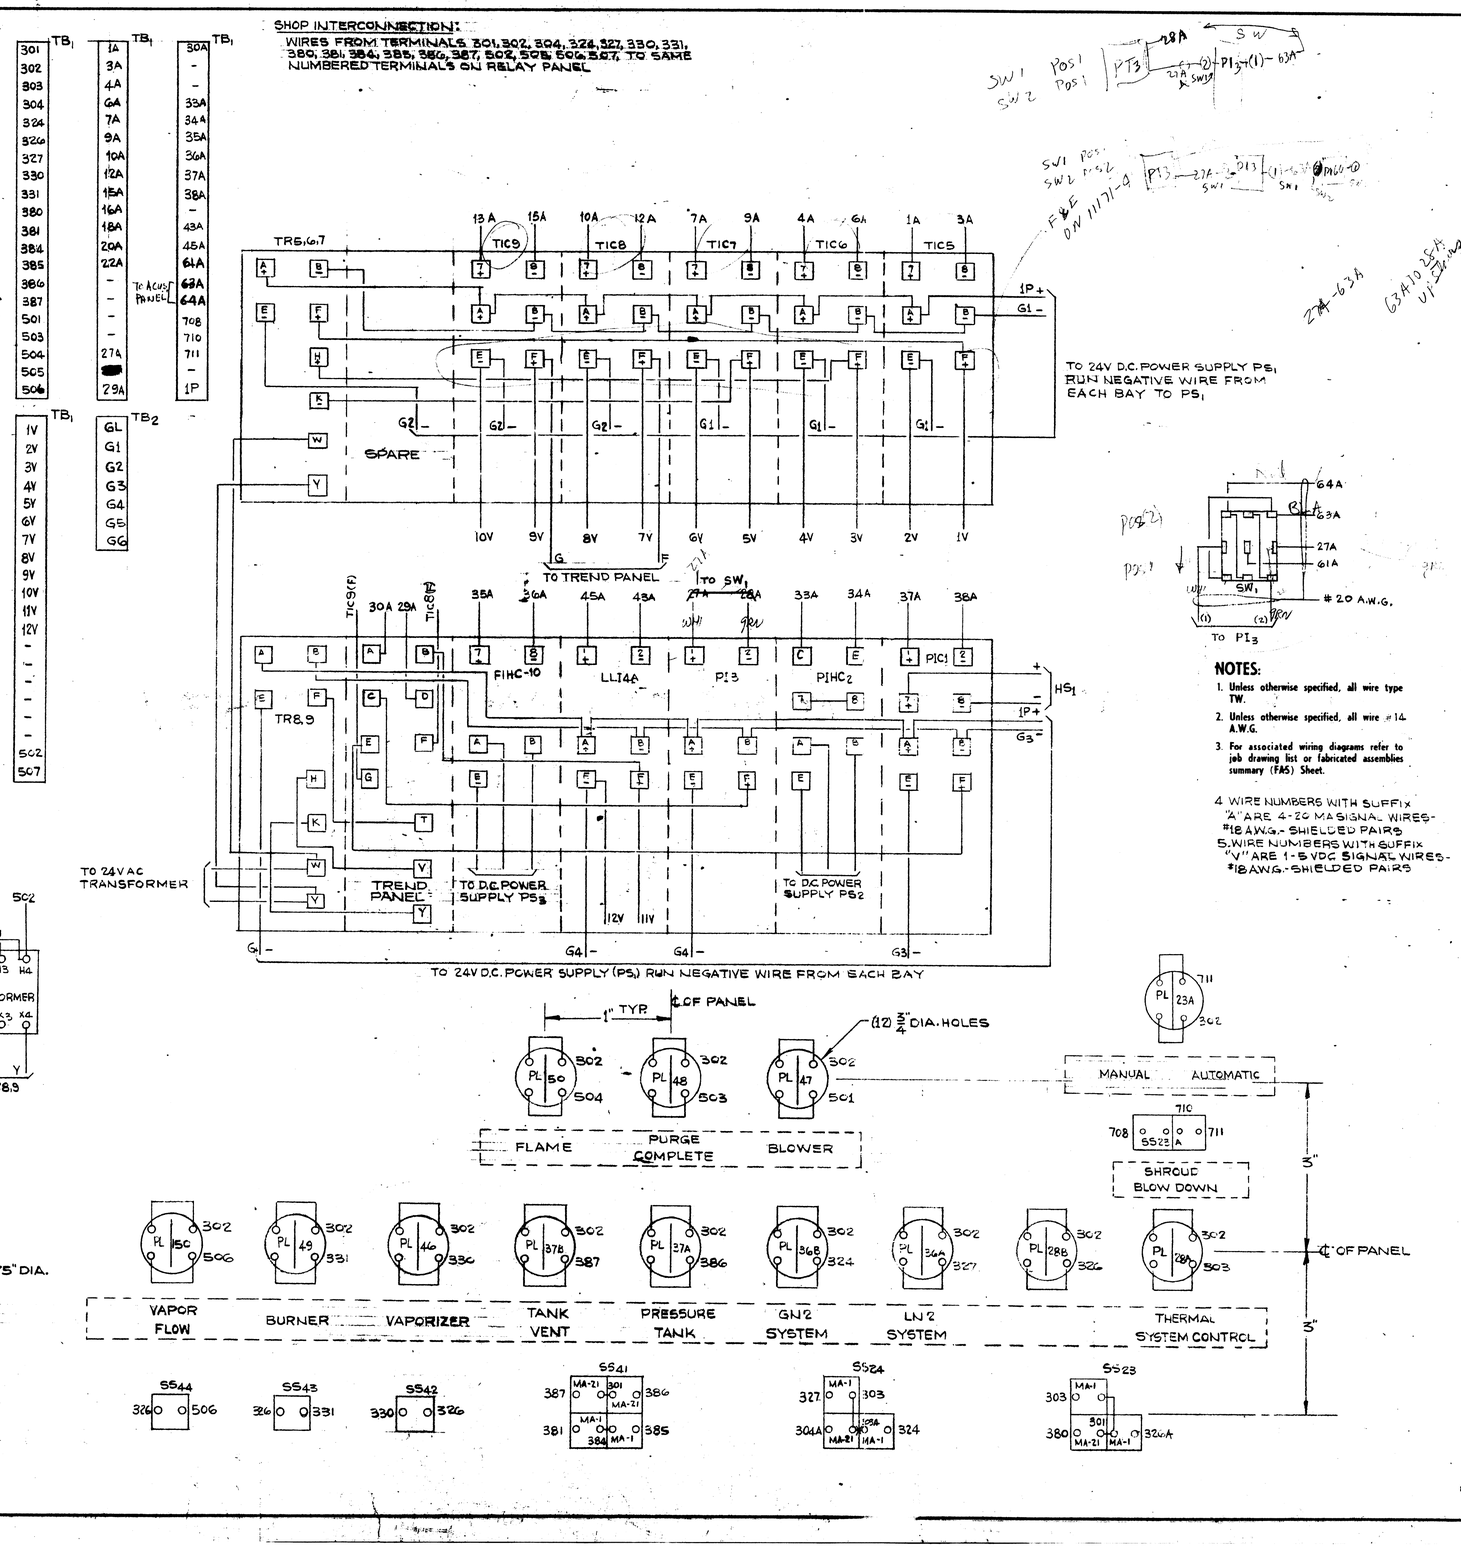

TINNEY ENGINEERING, INC.
UNION, N. J.

11172-4 C

JOB NUMBER 8440
NUMBER OF JOBS 1
QUANTITY PER JOB 1
B/M ISSUE
DATE BY

LN2/GN2 RELAY RACK WIRING

MODEL NO.

BILL OF MATERIAL / MATERIAL CONTROL & ACCOUNTING

IT. NO.	PC. NO.	NO. REQ'D	DESCRIPTION	TOTAL REQ'D	REQ'N. NO. & DATE	P.O. NO. & DATE	VENDOR	DATE REQ'D	DATE REC'D	TOTAL COST
	SS 23,24	2	SELECTOR SWITCH: SQ.'D" CLASS 9001, TYPE MSD-4B WITH CONTACT BLOCKS-(2) MA-1 & (1) MA-21							
	SS 41	1	SELECTOR SWITCH: SQ.'D" CLASS 9001 TYPE MSD-1B - X13							
	SS 42-44	3	SELECTOR SWITCH: SQ.'D' CLASS 9001 TYPE MSA-2B-X1							
	PL	12	TWIN INDICATOR LIGHT HOLDER DIALCO # 253-6939-1497-504							
		24	DATA LAMP: DIALCO #507-5338 0935-630							
	TB1	4	TERMINAL BOARD: E-109.3.1-8							
	TIC 5-9	5	BRISTOL METATRONIC INDICATING CONTROLLER MODEL 2752-21A-201-111-000 SCALE: -200 TO 0 TO +200° C		A					
	TR 5-9	2	BRISTOL 3-PEN METATRONIC RECORDER, MODEL 2711-30A-222-104-010-00N-PQR-100 CHART: -200 TO 0 TO +200°C		A					
		2	EIGHT BAY HOUSING FOR RELAY RACK MOUNTING MODEL 2700-10A-1B10200,		A					
	HS1	1	RELAY : E-103.1-3							
	PIC 1		BRISTOL METATRONIC INDICATING CONTROLLER-MODEL 2752-21A-291-111-000, SCALE: 7 1/2" TAPE SCALE (0-100)		A					
	PI3 LLI 4A	2	BRISTOL METATRONIC INDICATOR MODEL 2751-10A-120-101-000 SCALE 0-100		A					
	FIHC 10	1	BRISTOL METATRONIC MANUAL LOADING STATION: MODEL 2754-01A-211-000, 4-20 MA INPUT, SCALE 0-10 [redacted] EVEN		A					
		1	BRISTOL METATRONIC TREND PANEL MODEL 2781-10A-100		A					
	CI1	1	BRISTOL DYNAMASTER 24 POINT RECORDER MODEL 24P6570-21, RANGE -200 TO [illegible]		A					
			CONSTANTAN, CHART NO R1558 115V-60~ POWER SUPPLY							
	TB 2	1	TERMINAL BOARD: E-109.3.3-2							
	TR	1	TRANSFORMER: ACME # T-81050							
	PS1	1	D.C. POWER SUPPLY: WANLASS #120-OEM-3		A					
	PIHC 2	1	BRISTOL METATRONIC MANUAL LOADING STATION: MODEL 2745-10A-211-000, 4-20 MA OUTPUT AND INPUT		A					
	PS2, 3	2	POWER SUPPY: BRISTOL METATRONIC # 2007-40B		A					
	SS1M	1	SELECTOR SWITCH: SQ.D CLASS 9001, TYPE MSD-1B W/ (2) MA-1 CONTACT BLOCK							
1201	SW1	1	TOGGLE SWITCH: E-105.1-9							

LET.	DATE	REVISION	
C		REVISED PER FIELD CHANGES.	
B		REVISED PER FIELD CHANGES.	
A		ADDED WIRING TO LLI 4 & TEMPERATURE TRANSMITTER. DELETED PIC2, PIC10, ADDED PIHC2, FIHC10, PS2, 3	ALH 1-8-74

DWN. BY: ALH 8-21-74 CHK'D:
DWG ISSUE: 9-2-74 APPD:

SURFACE FINISH ✓ | FRAC. DIM. ± | DEC. DIM. ± | ANGLE DIM. ±
TOLERANCES UNLESS OTHERWISE SPECIFIED

11172-4 C